



INSTALLATION AND OPERATION MANUAL

cod. 80132B / Edit 03 - 08/09 - ENG

1 • MAIN FEATURES

- 5 RJ45 Ethernet ports
- Autosense
- Up-link port
- 10/100Mbps

2 • INSTALLATION AND CONNECTION



This section contains the instructions necessary for correct installation of the GILOGIK II into the machine control panel or the host system and for correct connection of the system power supply, inputs, outputs and interfaces.



Before proceeding with installation read the following warnings carefully!
Remember that lack of observation of these warnings could lead to problems of electrical safety and electromagnetic compatibility, as well as invalidating the warranty.

Qualified staff

the installation and use of the system and components are only reserved at qualified staff.

Conform use

the system and relative components are usable exclusively to the use previewed in the manual
 In order to guarantee a correct and sure operation are indispensable that the product comes transported, stored correctly, installed, and controlled second the previewed modalities.
 Suitable for use in pollution degree 2 environment.
 Open type equipment.

Electrical power supply

- the GILOGIK II is NOT equipped with an On/Off switch: the user must provide a two-phase disconnecting switch that conforms to the required safety standards (CE marking), to cut off the power supply upstream of the system. The switch must be located in the vicinity of the system and must be within easy reach of the operator.
 One switch may control more than one systems.
- To make sure that the system very is connected to earth second the detailed lists of the relative understood one it.
- if the system is used in applications with risk of damage to persons, machinery or materials, it is essential to connect it up to auxiliary security equipment. It is advisable to make sure that alarm signals are also triggered during normal operation. The dispositif must NOT be installed in flammable or explosive environments; it may be connected to equipment operating in such atmospheres only by means of appropriate and adequate types of interface, conforming to the applicable safety standards.

Notes Concerning Electrical Safety and Electromagnetic Compatibility:

- **CE MARKING: EMC Conformity (electromagnetic compatibility)** in accordance with EEC Directive 2004/104/CE.
 The GILOGIK II system is mainly designed to operate in industrial environments, installed on the switchboards or control panels of productive process machines or plants.
 Norm of applicable product EN 61131-2.
 The Declaration of conformity is available on GEFRAN web: www.gefran.com
- **UL listed standard:** UL508 file E198546
- **BT Conformity (low tension)** in accordance with Directive LVD 2006/95/CE.
 Advice for Correct Installation for EMC

Module power supply

- Supply with class 2 device
- The power supply to the modules on the switchboards must always come directly from an isolation device with a fuse.
- The electronic instruments and electromechanical power devices such as relays, contactors, solenoid valves, etc., must always be powered by separate lines.
- When the power supply is strongly disturbed by the commutation of transistor or power units or motors, an isolation transformer should be used, earthing the screen.
- It is essential that the plant has a good earth connection:
 - the voltage between neutral and earth must not be > 1V
 - the Ohmic resistance must be < 6Ω;
- In the proximity of high frequency generators or arc welders, use adequate filters.
- The power supply lines must be separate from the instrument input and output ones.



GEFRAN S.p.A. declines all responsibility for any damage to persons or property caused by tampering, neglect, improper use or any use which does not conform to the characteristics of the controller and to the indications given in these Instructions for Use.

3 • TECHNICAL DATA

Power supply

- supply with class 2 device
- external 24Vdc $\pm 25\%$ 0,5A
- extractible connector 2 poles

Ethernet

- priority slots
- 10/100 baseTx connection
- Store & Forward
- Standard IEEE 802.3
- Autosense

Diagnostics

- POWER led: power on

- LINK led: network connected
- ACTIVITY led: data transfer

MECHANICAL DATA

Dimensions: 92x90x25,4mm

Weight: 150g.

Protection level: IP20

AMBIENT CONDITIONS



Working Temperature: 0...50°C

Storage Temperature: -20...70°C

Humidity: max. 90% Rh not condensing

For UL: Maximum surrounding air temperature 50°C

4 • CONNECTIONS

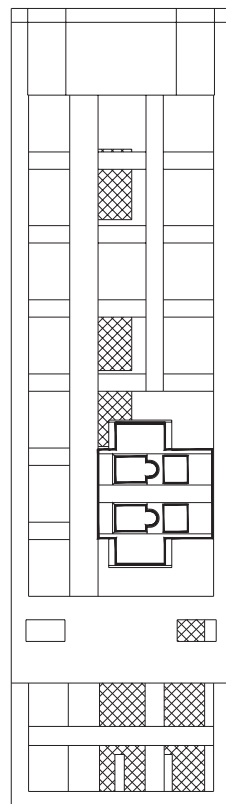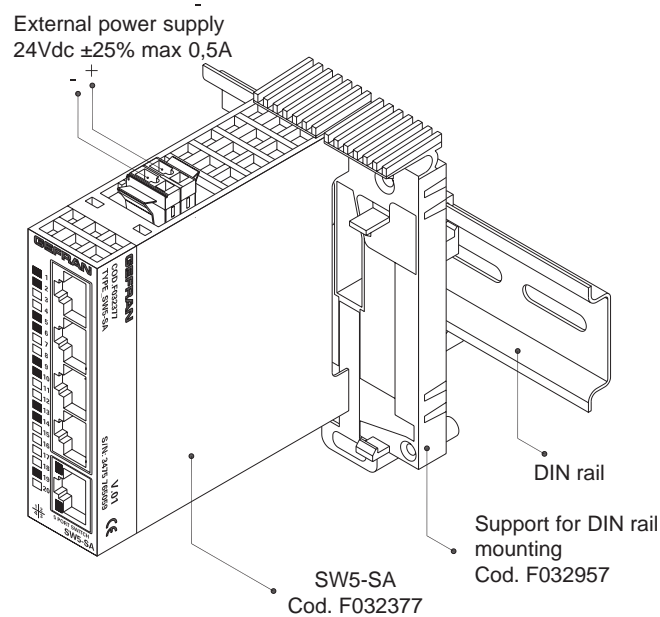

External power supply

- + 24Vdc
- $\pm 25\%$
- - Max 0,5A

4 • CONNECTIONS

Front connections:

5 Ethernet ports; RJ45 8-wire connector; use standard category 6 cable subject to TIA/EIA-568A (see appendix B).

Top connector 2 poles: external power supply 24Vdc \pm 25%.

